




Strip conductor to 9 - 10 mm / 0.37 in.

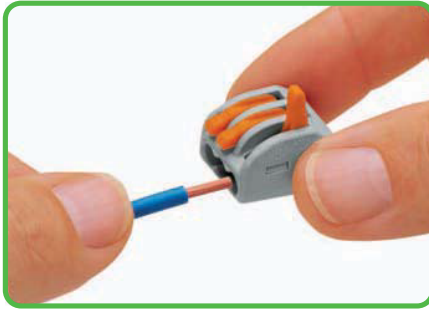



Conductor termination: Open clamping unit using the lever and insert conductor.

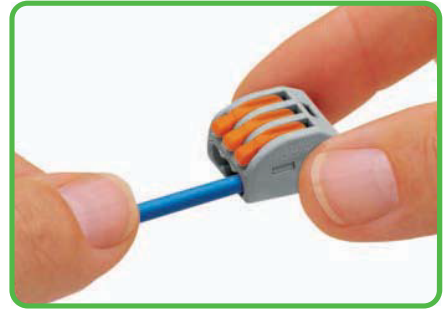


Then lower lever to close the clamp.

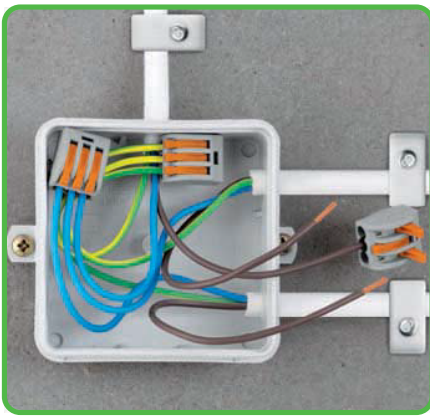

Wiring fine-stranded conductors in a junction box.

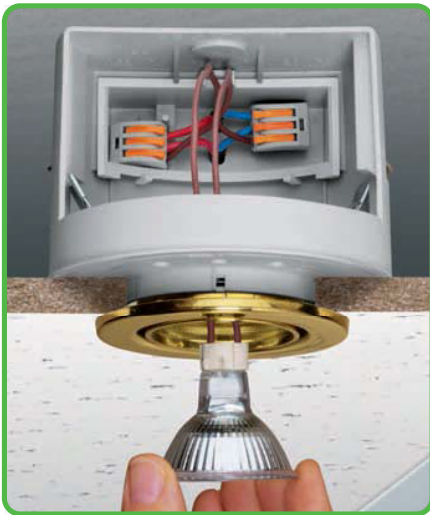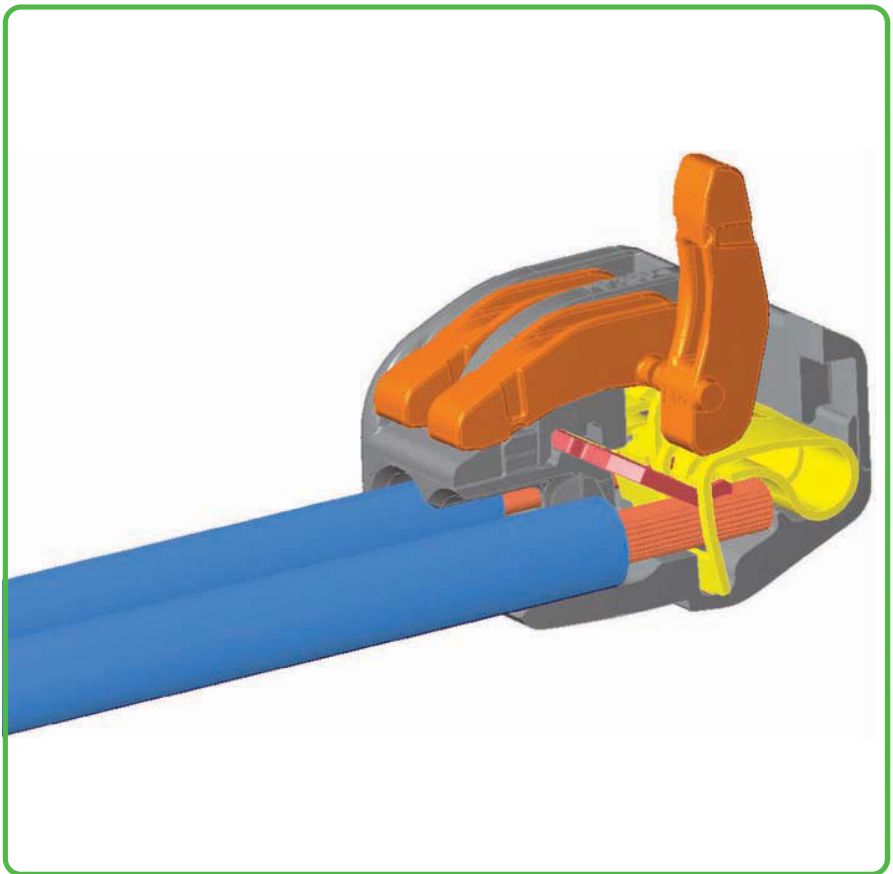

Individual design of low-voltage lighting systems.

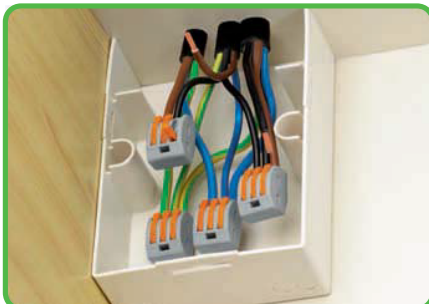

Connecting pre-wired and pre-fabricated components; e.g., modular assemblies used in mobile homes.



Lighting fixture connected with flexible power feed.

CAGE CLAMP®
clamps the following
copper conductors:*

- solid
- stranded

* For aluminum conductors, see notes in Section 14.

❶ When using ferrules, the max. conductor cross section accommodated is one size smaller than max. rating of terminal block.

fine-stranded,
also with tinned
single strands

fine-stranded,
tip-bonded

fine-stranded,
with ferrule ❶
(gastight crimped)

fine-stranded,
with pin terminal
(gastight crimped)