

Test disconnect terminal block - URTK/S - 0311087

Please be informed that the data shown in this PDF Document is generated from our Online Catalog. Please find the complete data in the user's documentation. Our General Terms of Use for Downloads are valid (<http://download.phoenixcontact.com>)



Test disconnect terminal block, Connection method: Screw connection, Cross section: 0.5 mm² -10 mm² , AWG: 20 - 10, Width: 8.2 mm, Mounting type: NS 35/7,5, NS 35/15, NS 32, Color: gray

Product Features

- Easy and clear testing in current transformer secondary circuits can be performed using the test disconnect terminal blocks of the URTK/S range
- On both sides of the disconnect point, the terminal block has a test socket which can also be used to switch across to neighboring terminal blocks

Key commercial data

package_quantity	50
GTIN	4017918001292

Technical data

General

Number of levels	1
Number of connections	2
Color	gray
Insulating material	PA
Inflammability class according to UL 94	V0

General

Rated surge voltage	6 kV
Pollution degree	3
Surge voltage category	III
Insulating material group	I
Connection in acc. with standard	IEC 60947-7-1
Nominal current I _N	41 A
Nominal voltage U _N	400 V
Open side panel	ja
Shock protection test specification	DIN EN 50274 (VDE 0660-514):2002-11
Back of the hand protection	guaranteed
Surge voltage test setpoint	7.3 kV
Result of surge voltage test	Test passed
Power frequency withstand voltage setpoint	1.89 kV

Test disconnect terminal block - URTK/S - 0311087

Technical data

General

Result of power-frequency withstand voltage test	Test passed
Checking the mechanical stability of terminal points (5 x conductor connection)	Test passed
Bending test rotation speed	10 rpm
Bending test turns	135
Bending test conductor cross section/weight	0.5 mm ² / 0.3 kg
Bending test conductor cross section/weight	6 mm ² / 1.4 kg
Bending test conductor cross section/weight	10 mm ² / 2 kg
Result of bending test	Test passed
Conductor cross section tensile test	0.5 mm ²
Tractive force setpoint	20 N
Conductor cross section tensile test	6 mm ²
Tractive force setpoint	80 N
Conductor cross section tensile test	10 mm ²
Tractive force setpoint	90 N
Tensile test result	Test passed
Tight fit on carrier	NS 32/NS 35
Setpoint	5 N
Result of tight fit test	Test passed
Result of voltage drop test	Test passed
Temperature-rise test	Test passed
Conductor cross section short circuit testing	6 mm ²
Short-time current	0.72 kA
Conductor cross section short circuit testing	10 mm ²
Short-time current	1.2 kA
Short circuit stability result	Test passed
Proof of thermal characteristics (needle flame) effective duration	30 s
Result of thermal test	Test passed
Temperature index, insulating material (DIN EN 60216-1 (VDE 0304-21))	130 °C
Static insulating material application in cold	-60 °C

Dimensions

Length	72 mm
Width	8.2 mm
Height NS 35/7,5	51.5 mm
Height NS 35/15	59 mm
Height NS 32	56.5 mm

Connection data

Note	Terminal point
Conductor cross section solid min.	0.5 mm ²

Test disconnect terminal block - URTK/S - 0311087

Technical data

Connection data

Conductor cross section solid max.	10 mm ²
Conductor cross section stranded min.	0.5 mm ²
Conductor cross section stranded max.	6 mm ²
Conductor cross section AWG/kcmil min.	20
Conductor cross section AWG/kcmil max	8
Conductor cross section stranded, with ferrule without plastic sleeve min.	0.5 mm ²
Conductor cross section stranded, with ferrule without plastic sleeve max.	6 mm ²
Conductor cross section stranded, with ferrule with plastic sleeve min.	0.5 mm ²
Conductor cross section stranded, with ferrule with plastic sleeve max.	4 mm ²
2 conductors with same cross section, solid min.	0.5 mm ²
2 conductors with same cross section, solid max.	2.5 mm ²
2 conductors with same cross section, stranded min.	0.5 mm ²
2 conductors with same cross section, stranded max.	6 mm ²
2 conductors with same cross section, stranded, ferrules without plastic sleeve, min.	0.5 mm ²
2 conductors with same cross section, stranded, ferrules without plastic sleeve, max.	4 mm ²
2 conductors with same cross section, stranded, TWIN ferrules with plastic sleeve, min.	0.5 mm ²
2 conductors with same cross section, stranded, TWIN ferrules with plastic sleeve, max.	4 mm ²
Connection method	Screw connection
Stripping length	13 mm
Internal cylindrical gage	A5
Screw thread	M4
Tightening torque, min	1.2 Nm
Tightening torque max	1.5 Nm

classifications

eCl@ss

eCl@ss 4.0	27141126
eCl@ss 4.1	27141126
eCl@ss 5.0	27141126
eCl@ss 5.1	27141126
eCl@ss 6.0	27141126
eCl@ss 7.0	27141126
eCl@ss 8.0	27141126

ETIM

ETIM 2.0	EC000902
----------	----------

Test disconnect terminal block - URTK/S - 0311087

classifications

ETIM

ETIM 3.0	EC000902
ETIM 4.0	EC000902
ETIM 5.0	EC000902


UNSPSC


UNSPSC 6.01	30211811
UNSPSC 7.0901	39121410
UNSPSC 11	39121410
UNSPSC 12.01	39121410
UNSPSC 13.2	39121410


approvals

CSA / UL Recognized / KEMA-KEUR / cUL Recognized / LR / DNV / RS / PRS / CCA / GOST / cULus Recognized /

Approval details

CSA 	
Nominal voltage UN	300 V
Nominal current IN	40 A
mm ² /AWG/kcmil	26-10

UL Recognized 	
Nominal voltage UN	300 V
Nominal current IN	50 A
mm ² /AWG/kcmil	26-8

KEMA-KEUR 	
Nominal voltage UN	400 V
Nominal current IN	
mm ² /AWG/kcmil	6

Test disconnect terminal block - URTK/S - 0311087

approvals

cUL Recognized	
Nominal voltage UN	300 V
Nominal current IN	50 A
mm ² /AWG/kcmil	26-8

LR

DNV

RS

PRS

CCA	
Nominal voltage UN	400 V
Nominal current IN	
mm ² /AWG/kcmil	6

GOST

cULus Recognized

accessories

End cover

D-URTK - 0310020



Partition plate

Test disconnect terminal block - URTK/S - 0311087

accessories

TS-RTK - 0310211



Partition plate

ATS-RTK - 0310224



Terminal marking

SBS 8:UNBEDRUCKT - 1007235



ZB 8:UNBEDRUCKT - 1052002



UC-TM 8 - 0818072



Test disconnect terminal block - URTK/S - 0311087

accessories

UCT-TM 8 - 0828740



Screwdriver tools

SZS 1,0X4,0 VDE - 1205066



Cover profile

AP-ME METER - 3034361



APT-ME - 3034358



End block

APH-ME - 3034374



Test disconnect terminal block - URTK/S - 0311087

accessories

CLIPFIX 35 - 3022218



CLIPFIX 35-5 - 3022276



E/NS 35 N - 0800886



E/UK - 1201442



E/UK 1 - 1201413



Bridge

Test disconnect terminal block - URTK/S - 0311087

accessories

FB 10- RTK/S - 0311171



EB 2- 8 - 0202154



EB 3- 8 - 0202141



EB 10- 8 - 0202138



ASB 2-RTK/S - 0311281



USB 2-RTK/S - 0311278



Test disconnect terminal block - URTK/S - 0311087

accessories

SB 4-RTK/S - 0311265



SB 2-RTK/S - 0311236



EB 4- 8 - 0202142



EB 3- 8/ST - 5020810



Switching lock

S - 0308359



Mounting rail

Test disconnect terminal block - URTK/S - 0311087

accessories

NS 32 PERF 2000MM - 1201002



NS 32 UNPERF 2000MM - 1201015



NS 35/ 7,5 PERF 2000MM - 0801733



NS 35/ 7,5 UNPERF 2000MM - 0801681



NS 35/ 7,5 WH PERF 2000MM - 1204119



NS 35/ 7,5 WH UNPERF 2000MM - 1204122



Test disconnect terminal block - URTK/S - 0311087

accessories

NS 35/ 7,5 AL UNPERF 2000MM - 0801704



NS 35/ 7,5 ZN PERF 2000MM - 1206421



NS 35/ 7,5 ZN UNPERF 2000MM - 1206434



NS 35/ 7,5 CU UNPERF 2000MM - 0801762



NS 35/ 7,5 CAP - 1206560



Test disconnect terminal block - URTK/S - 0311087

accessories

NS 35/15 PERF 2000MM - 1201730



NS 35/15 UNPERF 2000MM - 1201714



NS 35/15 WH PERF 2000MM - 0806602



NS 35/15 WH UNPERF 2000MM - 1204135



NS 35/15 AL UNPERF 2000MM - 1201756



NS 35/15 ZN PERF 2000MM - 1206599



Test disconnect terminal block - URTK/S - 0311087

accessories

NS 35/15 ZN UNPERF 2000MM - 1206586



NS 35/15 CU UNPERF 2000MM - 1201895



NS 35/15 CAP - 1206573



NS 35/15-2,3 UNPERF 2000MM - 1201798



Labeled terminal marker

ZB 8 CUS - 0825011



Test disconnect terminal block - URTK/S - 0311087

accessories

UC-TM 8 CUS - 0824597



UCT-TM 8 CUS - 0829616



ZB 8,LGS:FORTL.ZAHLEN - 1052015



ZB 8,QR:FORTL.ZAHLEN - 1052028



ZB 8,LGS:L1-N,PE - 1052413



Test socket

Test disconnect terminal block - URTK/S - 0311087

accessories

PSBJ 3,5/18/6 FARBLOS - 0311391



PSBJ 3,5/18/6 BK - 0311388



PSBJ 3,5/18/6 GY - 0311375



PSBJ 3,5/18/6 VT - 0311362



PSBJ 3,5/18/6 GN - 0311359



PSBJ 3,5/18/6 YE - 0311346



Test disconnect terminal block - URTK/S - 0311087

accessories

PSBJ 3,5/18/6 BU - 0311333



PSBJ 3,5/18/6 RD - 0311320



PSBJ 3,5/18/6 WH - 0311317



PSBJ-URTK/S RD - 0311744



PSBJ-URTK/S BU - 0311757



Test disconnect terminal block - URTK/S - 0311087

accessories

PSBJ-URTK/S YE - 0311731



PSBJ-URTK/S GN - 0311760



PSBJ-URTK/S VT - 0311773



PSBJ-URTK/S BK - 0311728




Drawings

Circuit diagram



Test disconnect terminal block - URTK/S - 0311087


Circuit diagram

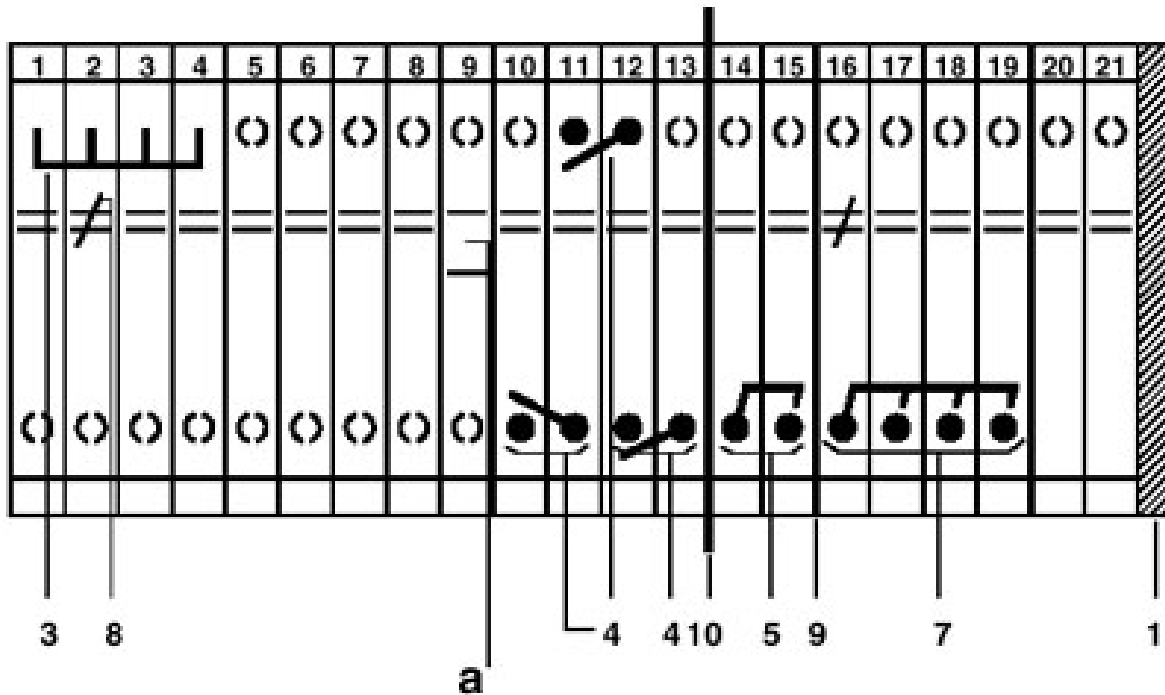

a = open
 1 = cover
 3 = fixed bridge
 4 = switch bar, for 2 terminal blocks, useable on both sides of the disconnect point, inward switching motion
 5 = switch bar, for 2 terminal blocks, useable on both sides of the disconnect point, outward switching motion
 7 = switch bar, for 3-phase short-circuiting of linked current transformer sets, only on the right
 8 = switching lock, prevents disconnect slide from being actuated
 9 = separating plate, for electrical separation of neighboring bridges in terminal center
 10 = partition plate


Test disconnect terminal block - URTK/S - 0311087

Schematic diagram

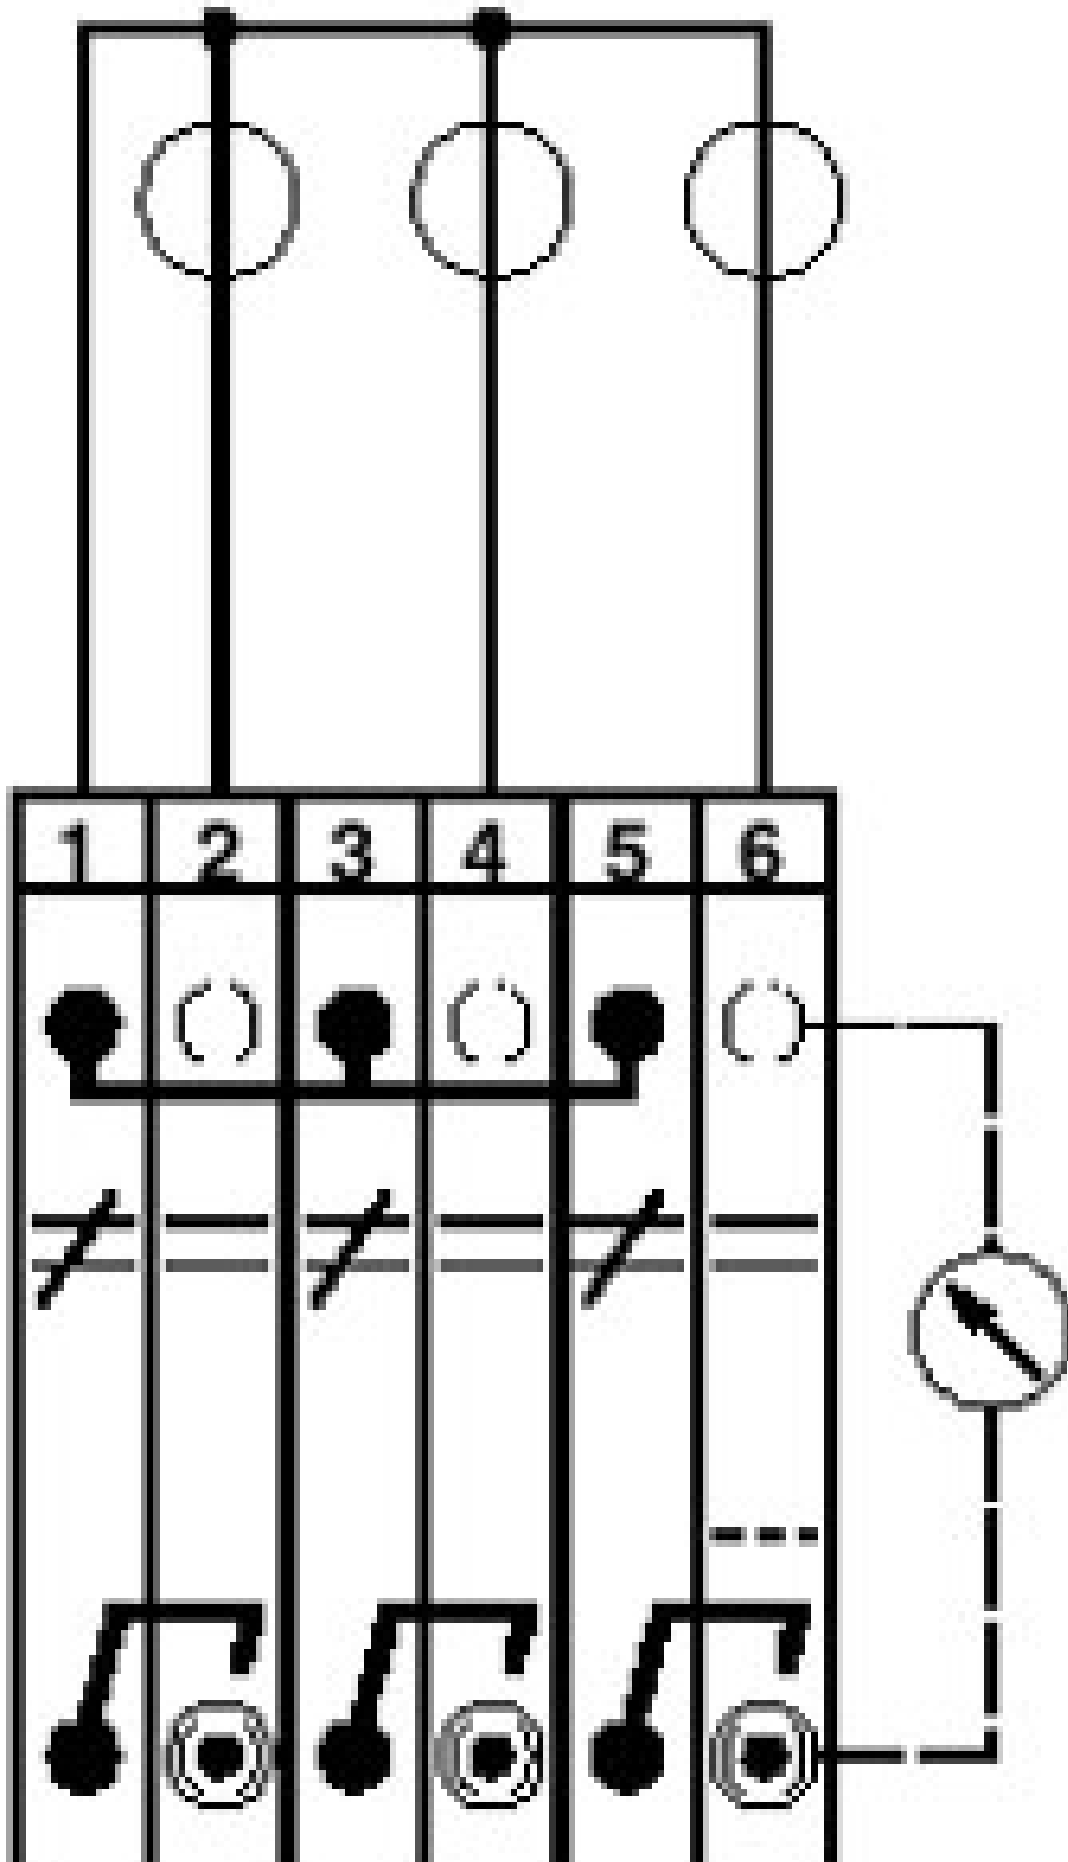


Test disconnect terminal block - URTK/S - 0311087

Schematic diagram

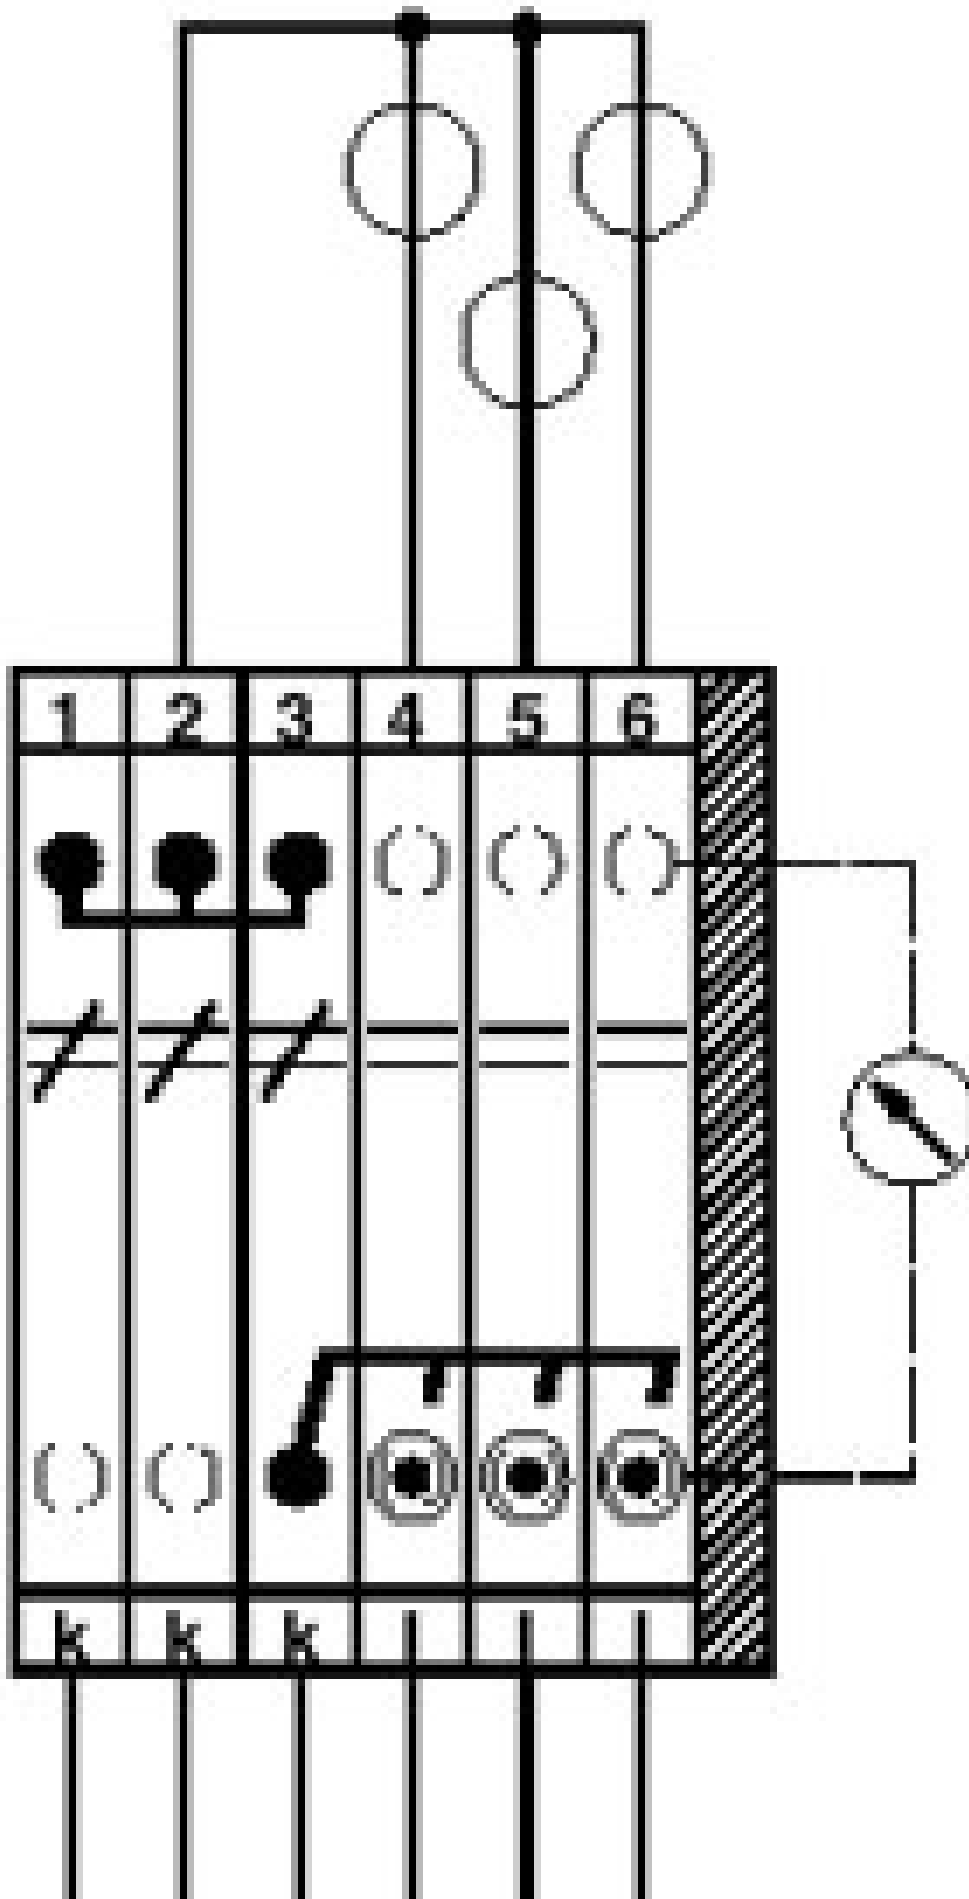

Test disconnect terminal block - URTK/S - 0311087

Schematic diagram

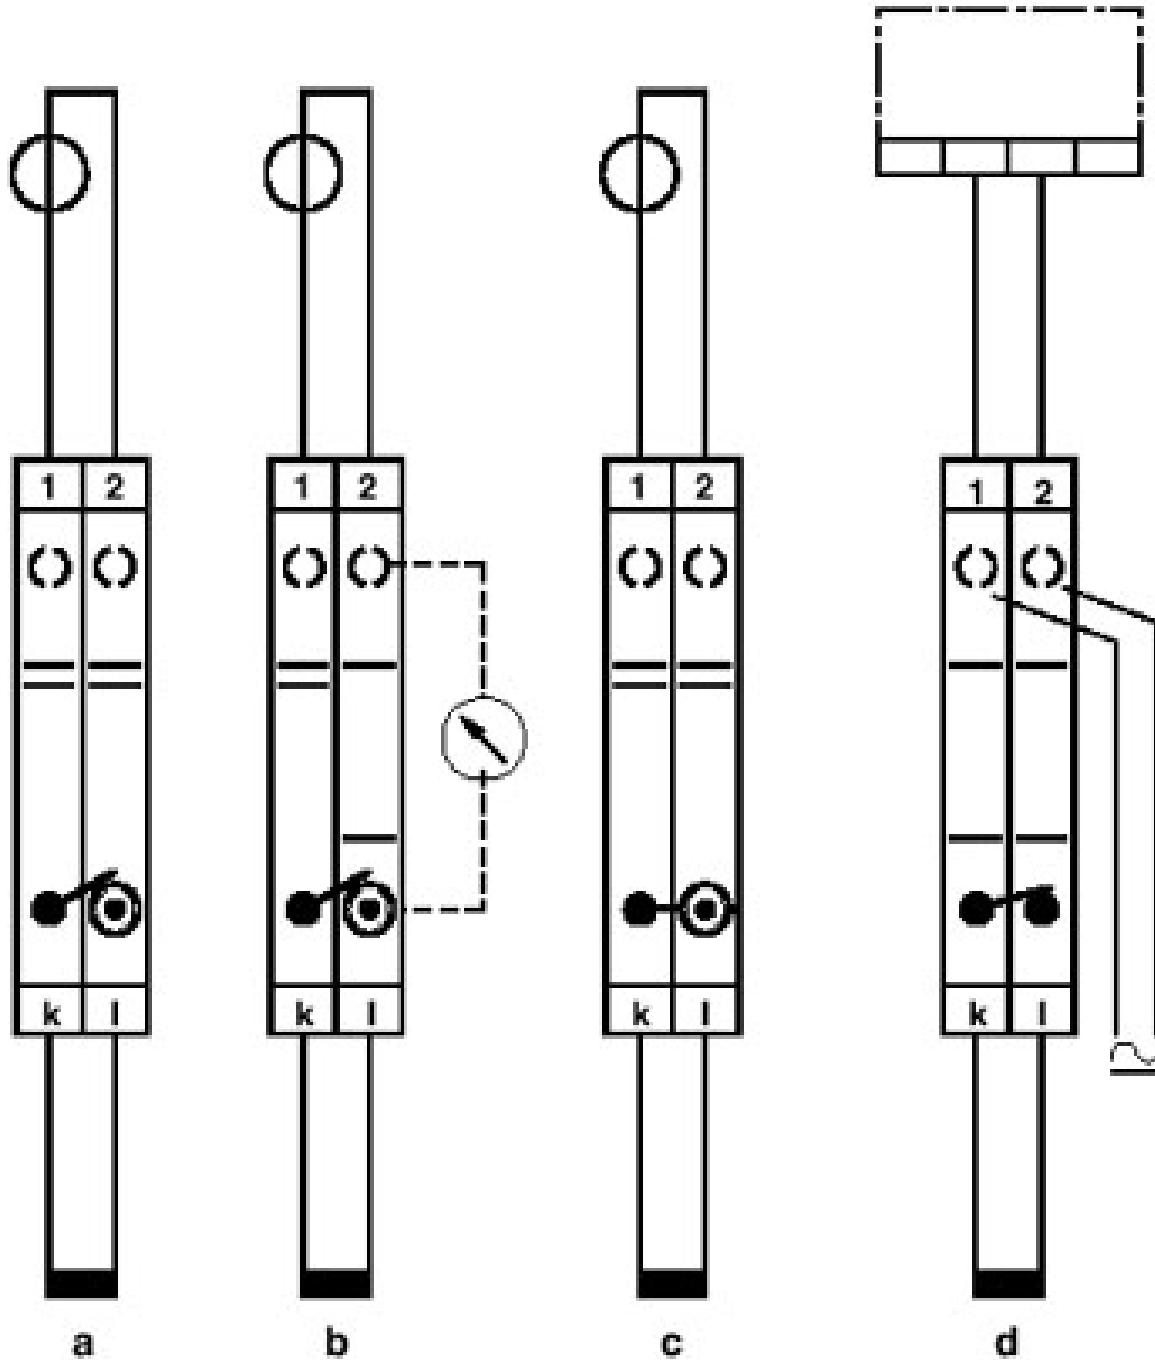

Simple current transformer test circuit
a = normal operation
b = measured value testing
c = transformer short-circuiting
d = relay testing

© Phoenix Contact 2014 - all rights reserved
<http://www.phoenixcontact.com>